



# SUBMITTAL INFORMATION

PIT SETTER 6050NL-2\_\_H3M3-VQ



3/4" REDUCED PORT METER VALVE INLET BY ANGLE DUAL CARTRIDGE CHECK VALVE OUTLET  
FOR 5/8" x 3/4" METER

3/4" CB COMPRESSION INLET X 3/4" MALE IRON PIPE OUTLET

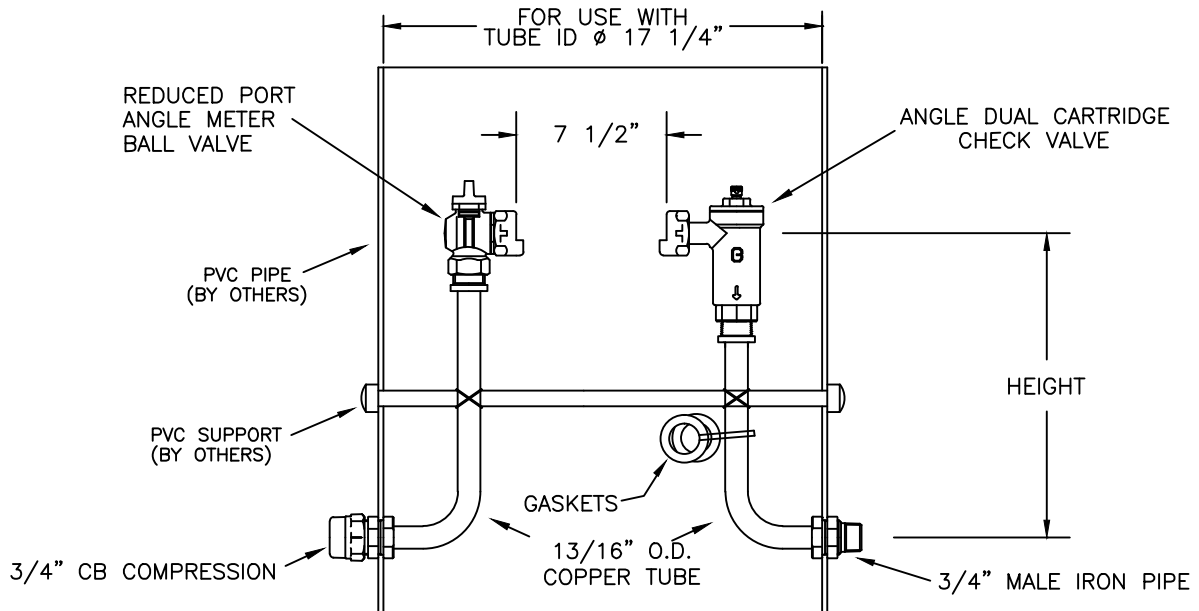

PIT DIAMETER	HEIGHT	CATALOG NUMBER	APPROX. WT. LBS.	SUBMITTED ITEM (S)
18"	7"	6050NL-207H3M3-VQ		
18"	15"	6050NL-215H3M3-VQ		
18"	18"	6050NL-218H3M3-VQ		
18"	28"	6050NL-228H3M3-VQ		

## FEATURES:

- MANUFACTURED IN COMPLIANCE WITH AWWA STANDARD C800 (ASTM B-584, UNS NO C89833).
- CONFORMS TO ANSI/NSF 61-8
- CONFORMS TO ANSI/NSF 372 (COMPLIANT WITH US Safe Drinking Water Act. PL 111-380)
- CHECK VALVE IS ASSE 1024 APPROVED
- ASSEMBLED WITH LEAD-FREE SOLDER.
- METER IS HELD RIGID FOR EASY INSTALLATION AND REMOVAL.
- PVC PIPE, SUPPORT AND BOX COVER NOT INCLUDED.
- SERVICE LINES ARE A MINIMUM OF 2" FROM PIT WALLS TO PREVENT "FROST JUMP".
- SADDLE NUTS HOLD THE METER IN PLACE FOR TIGHTENING.
- WHEN BOTTOM OF PIT IS BELOW FROST LINE, SERVICE AND METER FREEZE-UPS ARE GREATLY REDUCED OR ELIMINATED.
- FURNISHED WITH TWO EPDM RUBBER GASKETS FOR METER NUTS.
- BODY AND NUTS PROVIDE WRENCH FLATS FOR INSTALLATION

Cambridge Brass considers the information in this submittal form to be correct at the time of publication. Item and option availability, including specifications, are subject to change without notice.

Cambridge Brass  
P.O. Box 249, 140 Orion Place  
Cambridge, Ontario  
Canada N1R 5V1  
Tel: (519) 621-5520  
Fax: (519) 621-8674  
<http://www.cambridgebrass.com>



SUBMITTED BY: